



NOTES:

ELEVATION

- APPROVED PRECAST CONCRETE VAULT CARDER 60"
 GSTA OR 60" NSTA OR EQUAL CONFORMING TO
 ASTM DESIGNATION C478 AND WITHSTANDING
 AASHTO/H-20 LOADING.
- 2. THE PURPOSE OF THIS INSTALLATION IS TO ALLOW FOR RECORDING THE FLOWS IN THE PIPE OVER A PERIOD OF TIME WITH A DEVICE CALLED A PITOT TUBE, WHICH IS INSERTED INTO THE PIPE THROUGH THE CORPORATION STOP.
- 3. THE DISTANCE BETWEEN RUNGS, CLEATS, AND STEPS SHALL NOT EXCEED 12 INCHES AND SHALL BE UNIFORM THROUGHOUT THE LENGTH OF THE LADDER.

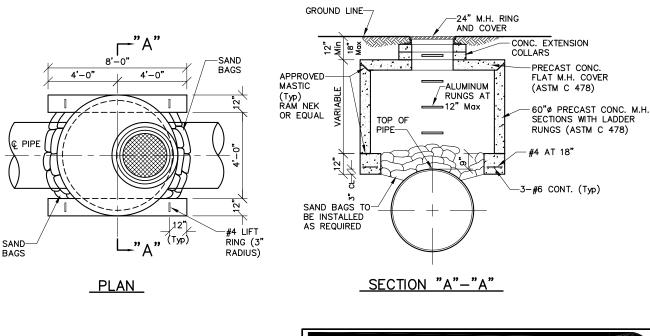

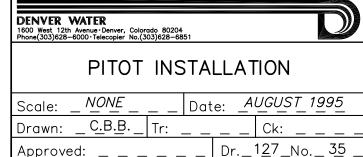

REVISED 5-2002